

Application note for setting disc spring type clamps


Introduction

This application note provides instructions on how to set a disc spring type clamp. The clamp range uses a two-rod system with disc springs to apply the required clamping force on the device. This force is achieved when the top disc spring(s) are just free to move.



This pre-calibrated force indicator eliminates the need for any special equipment or torque wrenches.

Instructions


1. After loosely assembling all the components with the capsule device between the heatsinks, finger tighten the two bolts.

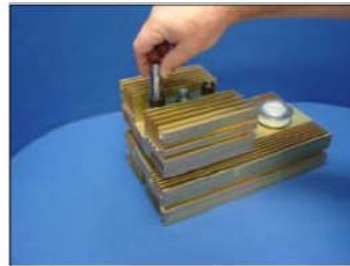

2. Check that the top bar is parallel with the heatsink and make sure that it is centrally located i.e. not at an angle to the channel in the heatsink.
3. Using a socket (wrench) tighten each bolt by a quarter turn alternately.

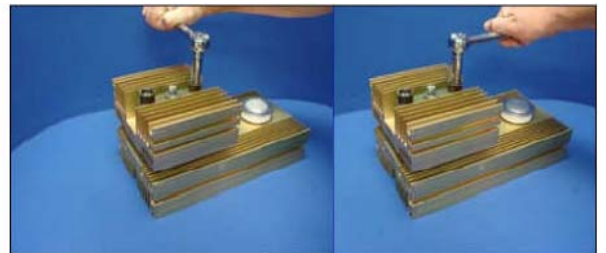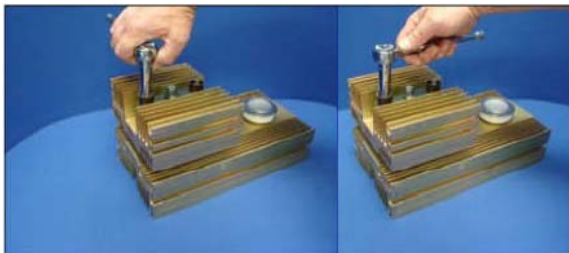

4. Check the top disc spring(s) after each bolt has been quarter turned. Correct force is applied when the washers are just free to move.

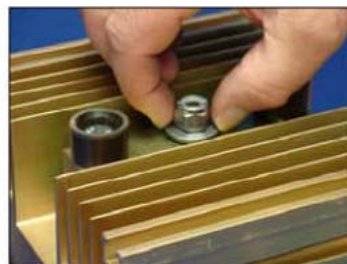

Important Notice:

This document is provided by Littelfuse, Inc. ("Littelfuse") for informational and guideline purposes only. Littelfuse assumes no liability for errors or omissions in this document or for any of the information contained herein. Information is provided on an "as is" and "with all faults" basis for evaluation purposes only. Applications described are for illustrative purposes only and Littelfuse makes no representation that such applications will be suitable for the customer's specific use without further testing or modification. Littelfuse expressly disclaims all warranties, whether express, implied or statutory, including but not limited to the implied warranties of merchantability and fitness for a particular purpose, and non-infringement. It is the customer's sole responsibility to determine suitability for a particular system or use based on their own performance criteria, conditions, specific application, compatibility with other components, and environmental conditions. Customers must independently provide appropriate design and operating safeguards to minimize any risks associated with their applications and products.

LITTELFUSE PRODUCTS ARE NOT DESIGNED FOR, AND SHALL NOT BE USED FOR, ANY PURPOSE (INCLUDING, WITHOUT LIMITATION, AUTOMOTIVE, MILITARY, AEROSPACE, MEDICAL, LIFE-SAVING, LIFE-SUSTAINING OR NUCLEAR FACILITY APPLICATIONS, DEVICES INTENDED FOR SURGICAL IMPLANT INTO THE BODY, OR ANY OTHER APPLICATION IN WHICH THE FAILURE OR LACK OF DESIRED OPERATION OF THE PRODUCT MAY RESULT IN PERSONAL INJURY, DEATH, OR PROPERTY DAMAGE) OTHER THAN THOSE EXPRESSLY SET FORTH IN APPLICABLE LITTELFUSE PRODUCT DOCUMENTATION. WARRANTIES GRANTED BY LITTELFUSE SHALL BE DEEMED VOID FOR PRODUCTS USED FOR ANY PURPOSE NOT EXPRESSLY SET FORTH IN APPLICABLE LITTELFUSE DOCUMENTATION. LITTELFUSE SHALL NOT BE LIABLE FOR ANY CLAIMS OR DAMAGES ARISING OUT OF PRODUCTS USED IN APPLICATIONS NOT EXPRESSLY INTENDED BY LITTELFUSE AS SET FORTH IN APPLICABLE LITTELFUSE DOCUMENTATION.

An application note for clamps and mounting information

Introduction

This application note aims to give guidance as to the clamps and the mounting information.

Bar Type

The bar clamps are suitable for devices having from 19mm to 75mm diameter mounting surfaces and 450kgf to 7000kgf clamping forces.

Coding

CMK	XXXX	S, D or DT	XX	M
Capsule Mounting Kit	Nominal Clamping Force kgf	S-Single side cooled (tapped heatsink) D-Double side cooled (through hole in heatsink) DT-Double side cooled (tapped heatsink)	Maximum Capsule Diameter mm	Metric Fixings M8, 10 or 12

Box Type

The box clamps are suitable for devices with 19mm, 25mm or 34mm diameter mounting surfaces and of 13.8mm or 14.6mm or 26.2mm nominal thickness respectively.

Coding

CMK	XXX	B	XX	M
Capsule Mounting Kit	Nominal Clamping Force kgf	Box Clamp	Capsule Mounting Surface Diameter 19 25 or 34mm	Metric Fixing Bolts (See chart)

Types Available

Type	Fixing centres (mm)	Rod size	Capsule devices		
			Outline	Mounting surface diameter (mm)	Nominal thickness (mm)
CMK 450 X 56M	65	M8	DO-200AA/TO-200AB	19.0	13.6
CMK 550 X 56M	65	M8	GTO	29.5	16.0
CMK 900 X 56M	65	M8	Diode/Thyristor	25.1	14.6
CMK 1100 X 76M	89	M10	DO-200A9/TO-200AC	34.0	26.2
CMK 1130 X 60M*	70	M8	DO-200ABI/TO-200AC	34.0	26.2
CMK 1130 X 76M	69	M10	DO-200AB/TO-200AC	34.0	26.2
CMK 2100 X 76M*	89	M10	GTO	47.0	27.0
CMK 2140 X 76M	09	M10	DO-200/Thyristor	47.0	26.8
CMK 2500 X 116M*	132	M12	GTO	63.0	26.0
CMK 3000 X 116M*	132	M12	DO-200AD/Thyristor	83.0	33.0
CMK 3500 X 116M*	132	M12	GTO	75.0	26.0
CMK 4000 X 118M*	132	M12	Diode/Thyristor	73.0	36.8
CMK 5000 X 128M*	146	M16	GTO	75.0	26.0
CMK 7000 X 126M*	146	M16	Diode/Thyristor	75.0	26.6
CMK 450B 19M	50 PCD	M5x50 Bolts	DO-200AA/TO-200A9	19.0	13.8
CMK 450B 25M	50 PCD	M5x50 Bolts	Diode/Thyristor	25.1	14.6
CMK 1500B 34M	70 PCD	M6x75 Bolts	DO-200AB/TO-200AC	34.0	26.2

*M for T_j up to 190°C, ML for T_j 125°C, note: 1KgF = 9.8N

Assembly Procedure for Capsule Clamps

The 'Bar Type' clamps use a two rod system with a straight bar spring that is bent over a central point to give the clamping force on the device. This force is achieved when the indicators (metal shims) at each end of the clamp, become pinched but able to be moved slightly with a pair of pliers.

The 'Box Type' clamps use a four bolt system with disc springs and the correct force on the device is achieved when the bottom of the box just touches the heatsink.

As the force indication is contained within these clamps, special equipment or torque spanners are not required. The clamps can therefore be reset to the correct force, at any time, using only a box spanner.

Bar Type: Double Side Cooled Assemblies

CMK450D56M, CMK1130D76M

- A1. Screw on to one end of each rod a full nut followed by a lock nut and tighten them against each other so that there is approximately 5mm of rod projecting through the lock nut.
 - A2. Place one plain washer over each rod against the full nut.
 - A3. Fit the locating pin into the heatsink (or heatsinks) making sure that the projection is less than the depth of the hole in the capsule (typically 1.5mm).
Warning. If the pin touches the bottom of the hole in the capsule or is not located in it correctly, it will not allow a good contact between the device and heatsink mounting surfaces. This will also damage the internal components of the capsule, which in turn will lead to device failure.
 - A4. Feed the rods through one Insulating block then the 0.15mm thick flexible insulator (if fitted) and then through the heatsink from the rear such that the flat surface of the block is towards the heatsink. Support the rods with the heatsink laid flat with its mounting surface uppermost.
 - A5. Prepare the heatsink and device mounting surfaces as detailed in 'Heatsink and Device Preparation'.
 - A6. Place the capsule on the heatsink located by the pin. See 'Warning' in A3.
 - A7. Place the insulating tubes over each rod and push them down through the block (if fitted).
 - A8. Position the top heatsink over the rods and lower it over the capsule. See 'Warning' in A3.
 - A9. Place the 0.15mm thick flexible insulator (if fitted) followed by the curved insulating block over the two rods with the flat surface towards the heatsink.
- Note:** The insulating tubes may need to be cut shorter to allow the block to touch the heatsink.
- A10. Place one spring gap indicator over each rod with the bend in each indicator over the ends of the block.
 - A11. Place the flat bar spring over the two rods.
 - A12. Place one plain washer over each rod and screw one full nut, finger tight, on to each rod such that the gap between the bar spring and the spring gap indicator is the same at both ends of the spring.
 - A13. Tighten each nut by a quarter turn alternately until the spring gap indicators become pinched. The indicators can be checked using a pair of pliers to ensure that the indicator can be moved slightly. At this point the correct force is applied to the device.
 - A14. When the assembly is in operation the gap between the indicator and the spring when the correct force is applied is between 0mm and 0.15mm.

CMK550D56M, CMK1100D76M

- B1. Proceed as for section A1 to A13 except in A4 feed the rods through the flat bar spring before the insulating block and in A13 tighten the nuts one sixth of a turn alternately.

CMK900D56M

- C1. Proceed as CMK450D56M except in A11 two flat bar springs are used.

CMK1130D60M

- D1. Proceed as CMK1100D76M except that the domed washers are fitted to the spring (detailed in G3 - flat part of domed washer towards the heatsink in A4, A10) and in A10 two spring gap indicators are used at each end.

CMK2100D76M

- E1. Proceed as CMK2140D76M except in A4 the curved block is replaced by two flat bar springs followed by the shaped metal block, with the flat surface towards the heatsink, and the flat insulating block. In A13 tighten the nuts one sixth of a turn alternately.

CMK2140D76M

- F1. Proceed as CMK1130D76M except that in A9 the curved insulating block is replaced by a flat insulating block followed by a shaped metal block with the flat surface towards the heatsink and in all two flat bar springs are used.

CMK2500/4000D116M, CMK5000/7000D116M

- G1. Screw the rods approximately 22mm into the metal block (fix with liquid thread lock if required).
- G2. Proceed as A3, A4, A5, A6, A7, AB and A10 (indicator bend away from the heatsink).
- G3. Fit the locating pin to the domed washer and assemble to the flat bar spring with a small amount of silicone grease between the washer and spring.
- G4. As A11, A12 and A13 (flat part of domed washer towards the heatsink in A11 and in A12) apply a small amount of silicone grease to the rods before fitting the nuts.
- G5. Fit the insulating cover (if supplied) to the metal block on the lower heatsink with the insulating screws.

CMK450DT56M, CMK1130DT76M

- H1. Screw the rods into the heatsink (typically 25mm) with sufficient rod out of the heatsink to accommodate the clamp components (fix with liquid thread lock if required).
- H2. Proceed as A3, A5 to A13.

CMK900DT56M

- J1. Proceed as CMK450DT56M except in A11 two flat bar springs are used.

CMK1130DT60M

- K1. Proceed-as CMK1130DT76M except that the domed washer is fitted to the spring (detailed in G3 - flat part of domed washer towards the heatsink in A9) and in A10 two spring gap indicators are used at each end.

CMK2140DT76M

- L1. Proceed as CMK1130DT76M except in A9 the curved insulating block is replaced by a flat insulating block followed by a shaped metal block, with the flat surface towards the heatsink and in A11 two flat bar springs are used.

Single Side Cooled Assemblies**CMK450S56M, CMK1130S76M**

- M1. Proceed as CMK450DT56M except at A8 position the conducting right angle bar on the device in place of the top heatsink.

CMK550S56M

- N1. Proceed as CMK450S56M except at A8 position the steel circular spacer between the conducting right angle bar and the insulating block.

CMK900S56M

- P1. Proceed as CMK450S56M except in A11 two flat bar springs are used.

CMK1130S60M

- R1. Proceed as CMK1130DT60M except that at A7 position the conducting right angle bar on the device¹ in place of the top heatsink.

CMK2100S76M

- S1. Proceed as CMK2140S76M except at A7 position the steel circular spacer between the conducting right angle bar and the insulating block.

CMK2140S76M

- T1. Proceed as CMK2140DT76M except at A8 position the conducting right angle bar on the device In place of the heatsink.

CMK3000S116M, CMK4000S116M

- U1. Proceed as CMK3000D116M except at A4 leave out the flat insulating block and at A7 position the conducting right angle bar on the device followed by the steel circular spacer. Followed by the flat insulating block followed by the flat steel block, in place of the heatsink. The cover detailed in F5 is not required.

Box Type**CMK450B19M, CMK450B25M, CMK1500B34M**

- V1. Prepare the heatsink and device as detailed in 'Heatsink and Device Preparation':
V2. Position the box clamp over the device making sure that the pins are correctly located see 'Warning' in A3.
V3. Position the square plate over the top of the central rod.
V4. Place a shake-proof washer (spring and plain on CMK1500B34M) on each of the four bolts and feed the bolts through the clamp whilst holding it in place.
V5. Screw the bolts into the heatsink finger-tight to the top of the square plate so that the distance from the bottom of the box and the heatsink is equal all the way around.
V6. Screw the bolts up a quarter turn at a time alternately (taking them clockwise 1, 2, 3 and 4 the tightening sequence is 1, 3, 2 and 4) until the box just touches the heatsink all the way around.

MODULE PM2

1. Prepare the heatsink and device as detailed in 'Heatsink and Device Preparation'.
2. Loosen and remove the M5 nuts from the four hexagonal headed screws.
3. Position the module on the heatsink and screw the four M5 screws into the heatsink finger-tight so that the distance between the bottom of the grey box and the black plastic base plate is equal all the way around.
4. Tighten the four screws alternately until the grey box just touches the black plastic base plate.

Note: The cheese head (slotted) screws, recessed below the black coated steel top plate, are for initial assembly only by IXYS UK WESTCODE, to hold the PM2 unit together during transit. Under no circumstances should any attempt be made to loosen or tighten these screws.

Heatsink and device preparation**Aluminium Heatsinks Capsule and Flat Base Devices**

- W1. Refer to application note 2008AN01.
W2. Where a locating pin is used, ensure that the device is accurately located upon the pin. Ensure that the pin projects from the heatsink less than the depth of the hole in the device. See 'Warning' in A3.

Stud Base Devices

- Y1. Ensure the device contact face is clean and then apply a thin film of mounting grease before mounting the device. Ensure that the threads are clean and free of mounting grease. Do not apply a turning force to any part of the device other than the hexagonal base. Ensure that the specific torque is applied using a suitable torque wrench.

Plated Copper Heatsinks

- Z1. When mounting capsule, flat base and stud devices on plated copper, ensure that the contact area of the device and heatsink is clean and apply a thin film of mounting grease to the contact face of the device only.

Notes

- (1) The lower insulating block must be backed up by a heatsink thickness suitable for the device loading otherwise the insulating block will break.
- (2) Do not position the circular steel spacer between the device and conducting right angle bar as this will give rise to additional volt drop.
- (3) Press the locating pin into the conducting right angle bar and circular spacer (if fitted) prior to assembling the clamp making sure that the projection is less than 1.5mm on either side see 'Warning' in A3.
- (4) Recommended mounting grease -ILEX SCX13 or PENETROX a-13.
- (5) Recommended machining tolerances over the device mounting area: Flatness, $W_t=30\mu\text{m}$, Roughness $R_a=1.6\mu\text{m}$.
- (6) It is permissible to use a scouring pad such as 'Scotchbrite' to remove stubborn dirt from device and heatsink contact surfaces followed by a clean rag or tissue.
- (7) Recommended lubrication - silicone grease RS555-083 or Rhone Poulenc 'Pate 4'.

Dismounting Procedure

It is as important to use the correct dismounting procedure as it is the mounting procedure. Where it is possible, the assembly should be removed from the equipment and placed horizontal on a clean workbench.

CAPSULE devices

With 'bar' clamps, the nuts should be loosened half a turn alternately (as for assembly), until they are 'finger tight'. The nuts can now be fully removed. Carefully lift off the top of the clamp. In the case of double side cooled units, the top heatsink should be lifted off and placed, upside down, on the work bench.


Note: the capsule semiconductor may stay attached to this heatsink, so care must be taken to avoid dropping it. Some form of protection for the mounting surface should be used - a clean cloth for example. If the capsule semiconductor remains firmly attached to a heatsink, it should be gripped firmly in the hand and rotated to attempt to release it. It may be necessary to remove the capsule from the heatsink by levering. Care must be taken to avoid damaging the ceramic or metal parts of the capsule,


If a 'box' clamp is used, release the four screws half a turn in rotation. Otherwise the procedure is as above.

Clean the mounting surfaces with a clean cloth. It should not be necessary to use a solvent liquid.

STUD BASE DEVICES

The same type of socket should be used as that for assembling. Pliers or similar devices should not be used as damage to the heatsink can be caused. When re-assembling, follow "Assembly Procedure".

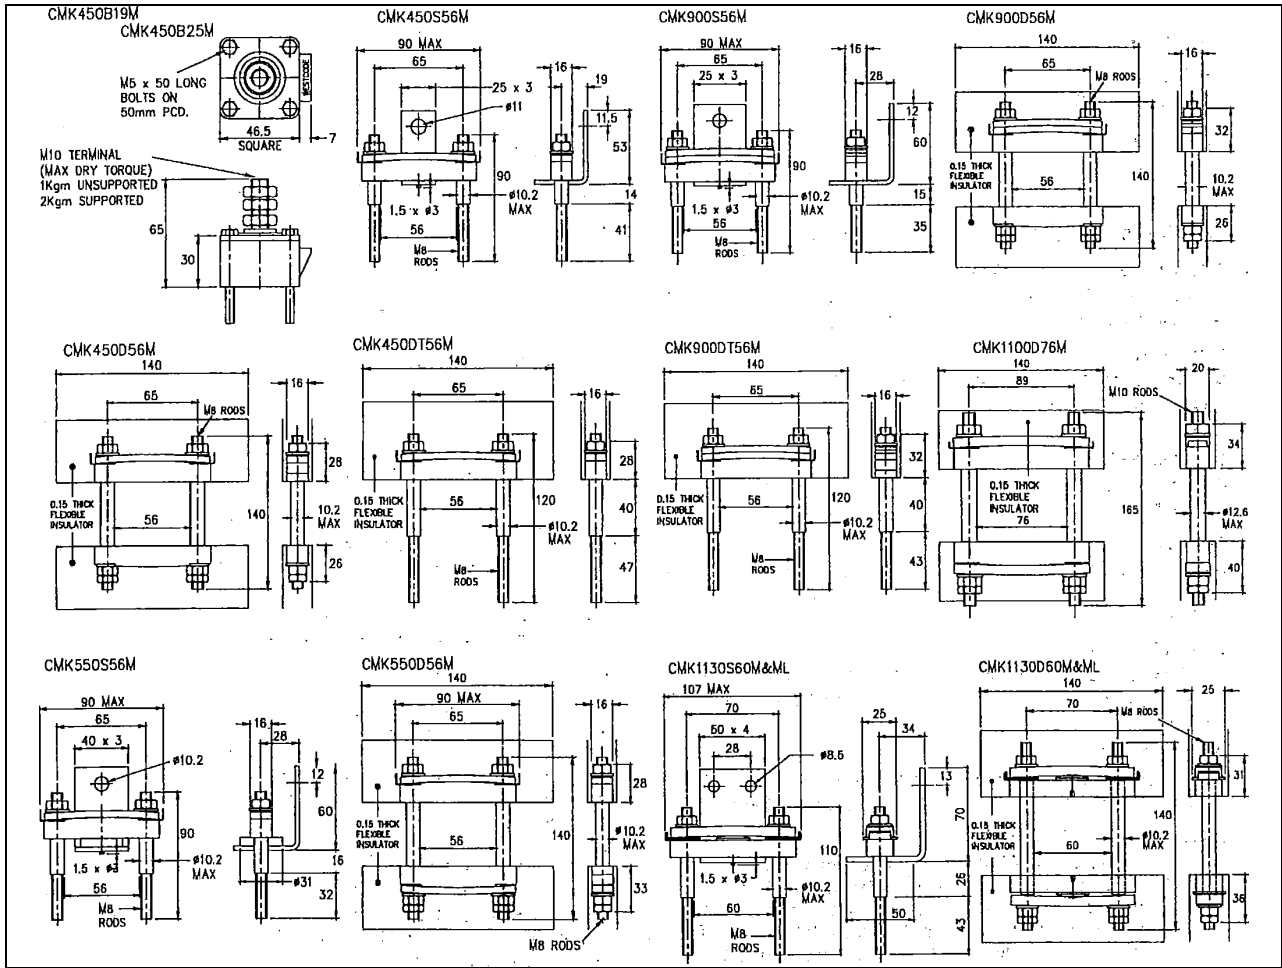

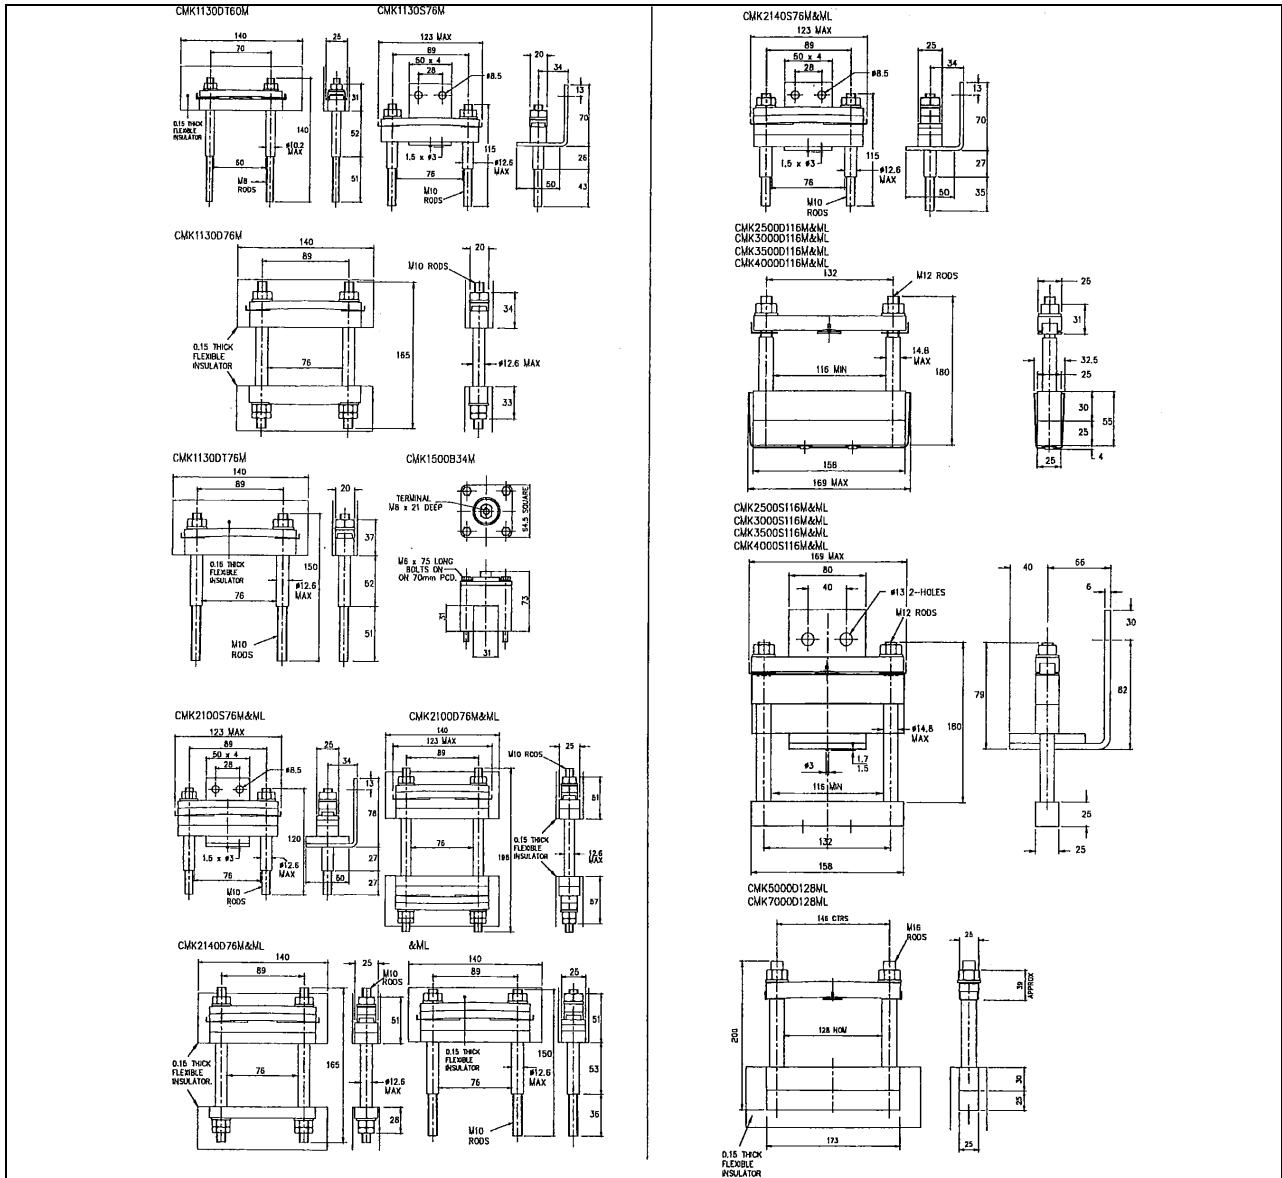

IXYS Semiconductor GmbH
Edisonstraße 15
D-68623 Lampertheim
Tel: +49 6206 503-0
Fax: +49 6206 503-627
E-mail: marcom@ixys.de

IXYS Corporation
1590 Buckeye Drive
Milpitas CA 95035-7418 USA
Tel: +1 (408) 457 9000
Fax: +1 (408) 496 0670
E-mail: sales@ixys.net



www.ixysuk.com

www.ixys.com

IXYS UK Westcode Ltd
Langley Park Way, Langley Park,
Chippenham, Wiltshire, SN15 1GE.
Tel: +44 (0)1249 444524
Fax: +44 (0)1249 659448
E-mail: sales@ixysuk.com

IXYS Long Beach
2500 Mira Mar Avenue
Long Beach CA 90815 USA
Tel: +1 (562) 296 6584
Fax: +1 (562) 296 6585
E-mail: service@ixyslongbeach.com

The information contained herein is protected by Copyright. And may not be used, copied, stored or disclosed except with the written permission of and in the manner permitted by the proprietors IXYS UK Westcode Ltd.

© IXYS UK Westcode Ltd.

In the interest of product improvement, IXYS UK Westcode reserves the right to change specifications or application notes at any time without prior notice.

Important Notice:

This document is provided by Littelfuse, Inc. ("Littelfuse") for informational and guideline purposes only. Littelfuse assumes no liability for errors or omissions in this document or for any of the information contained herein. Information is provided on an "as is" and "with all faults" basis for evaluation purposes only. Applications described are for illustrative purposes only and Littelfuse makes no representation that such applications will be suitable for the customer's specific use without further testing or modification. Littelfuse expressly disclaims all warranties, whether express, implied or statutory, including but not limited to the implied warranties of merchantability and fitness for a particular purpose, and non-infringement. It is the customer's sole responsibility to determine suitability for a particular system or use based on their own performance criteria, conditions, specific application, compatibility with other components, and environmental conditions. Customers must independently provide appropriate design and operating safeguards to minimize any risks associated with their applications and products.

LITTELFUSE PRODUCTS ARE NOT DESIGNED FOR, AND SHALL NOT BE USED FOR, ANY PURPOSE (INCLUDING, WITHOUT LIMITATION, AUTOMOTIVE, MILITARY, AEROSPACE, MEDICAL, LIFE-SAVING, LIFE-SUSTAINING OR NUCLEAR FACILITY APPLICATIONS, DEVICES INTENDED FOR SURGICAL IMPLANT INTO THE BODY, OR ANY OTHER APPLICATION IN WHICH THE FAILURE OR LACK OF DESIRED OPERATION OF THE PRODUCT MAY RESULT IN PERSONAL INJURY, DEATH, OR PROPERTY DAMAGE) OTHER THAN THOSE EXPRESSLY SET FORTH IN APPLICABLE LITTELFUSE PRODUCT DOCUMENTATION. WARRANTIES GRANTED BY LITTELFUSE SHALL BE DEEMED VOID FOR PRODUCTS USED FOR ANY PURPOSE NOT EXPRESSLY SET FORTH IN APPLICABLE LITTELFUSE DOCUMENTATION. LITTELFUSE SHALL NOT BE LIABLE FOR ANY CLAIMS OR DAMAGES ARISING OUT OF PRODUCTS USED IN APPLICATIONS NOT EXPRESSLY INTENDED BY LITTELFUSE AS SET FORTH IN APPLICABLE LITTELFUSE DOCUMENTATION.